


UZINA DE APA BAI 1 MAI

PTZ UZINA APA BAI 1 MAI
 BARA AL 60x5, 15kV

DATA: 30.06.2015
 ORA: 15:00
 SEMNATURA:

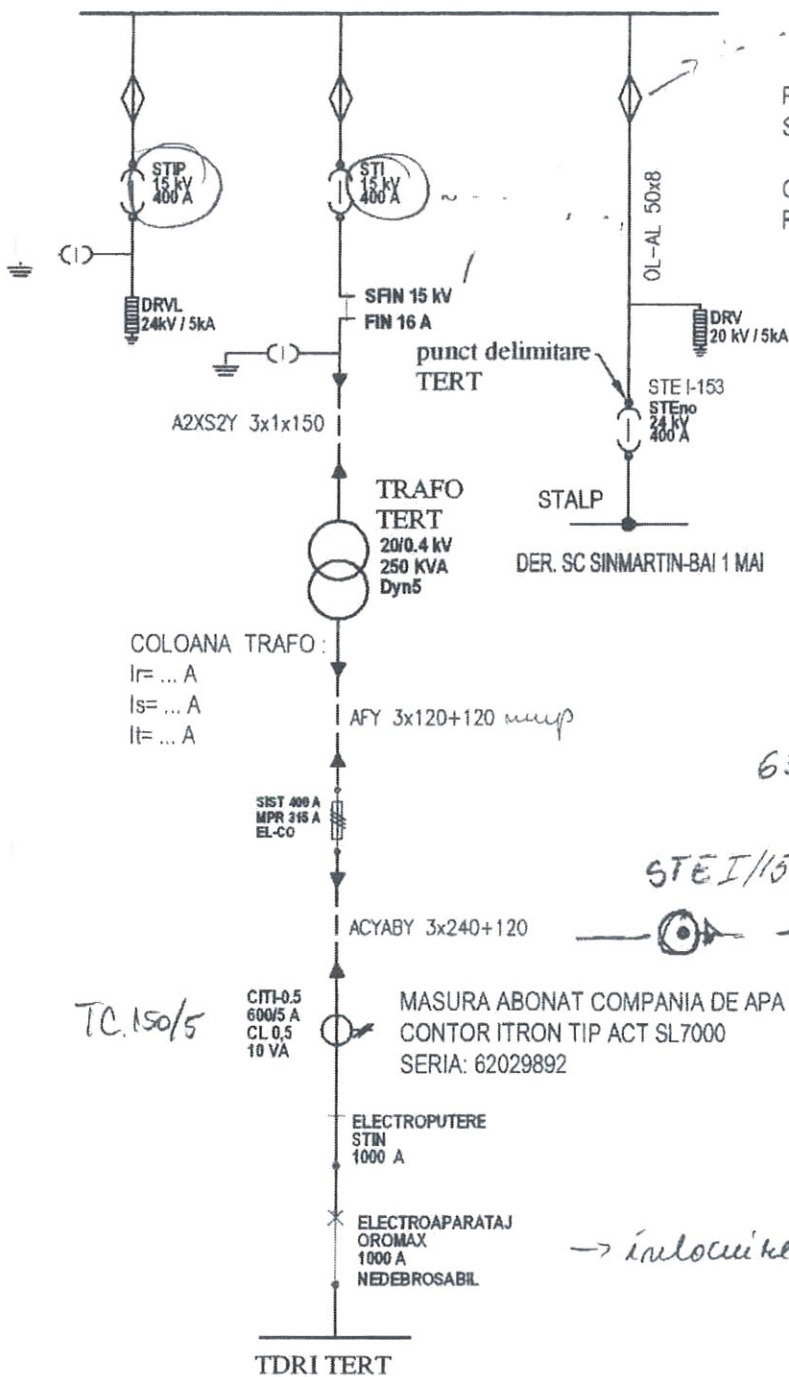

P.I.F.:
 S=...mp

z.v.02.2004

CELULE
 PRODUCATOR:

ELECTROPUTERE
 SEPARATOARE MT - ELECTROPUTERE
 DESCARCATOR MT - ELECTROCERAMICA TURDA
 SEPARATOR JT - ELECTROPUTERE
 INTREURATOR JT - ELECTROAPARATAJ
 TC - ELECTROPUTERE

◇ - Izolator de trecere la 20kV

sef CEMJT ing. POP FLORIAN

CL
 CF.....
 234V 630/200A

630A ↓
 ↓ 200A

STE I/153

16A

Now proiectat

TC.150/5

20/0.4kV
 250kVA

→ inlocuite la 400A